


Standard Tank One (Approximately 1500 gallons)

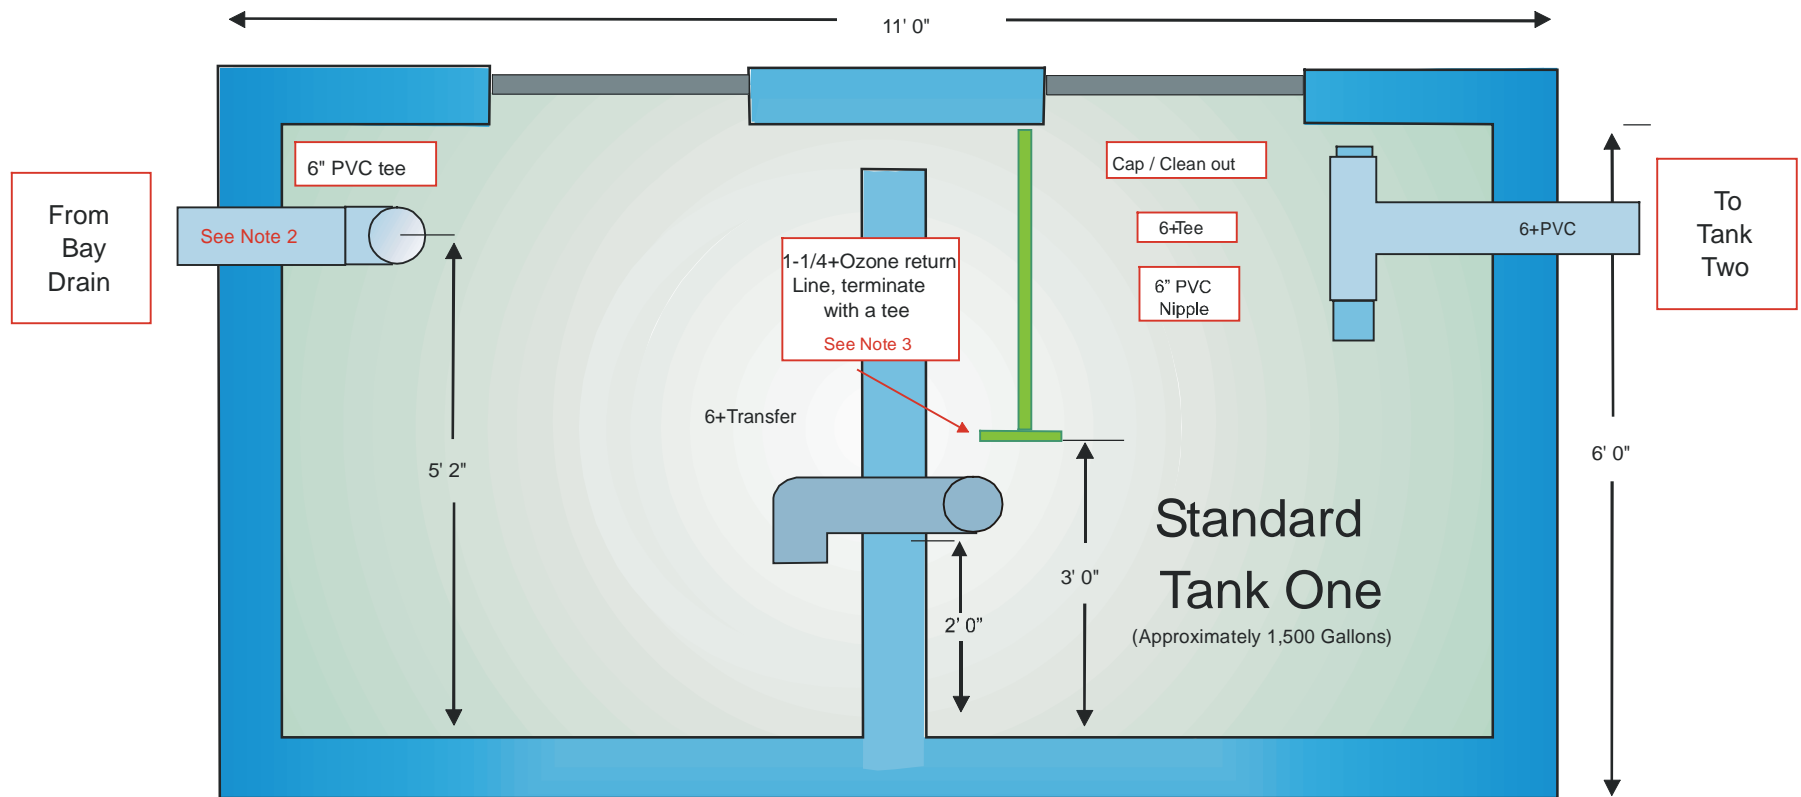

Hole 1 - The Tank Dimensions will vary slightly depending on location. It is important to keep the Tank capacity approximately 1500 gallons and piping layout as close to the above dimensions as possible.

Hole 2 - The 6+line from the wash bay should terminate just inside the tank wall with a PVC Tee. This will reduce turbulence in the Grease & Oil Trap option of Tank One.

Hole 3 - Ozone return line should enter tank one approximately at the mid section of Tank wall and extend down into the tank approximately 3q(foot). Then Terminate the 1-1/4+ Ozone Pipe with a 1-1/4+ PVC Tee. This will distribute the Ozone Bubbles towards the entrance and exit of Tank One.

