


# Typical 2 Bay Automatic Standard 2 Bay Using Trench Drain

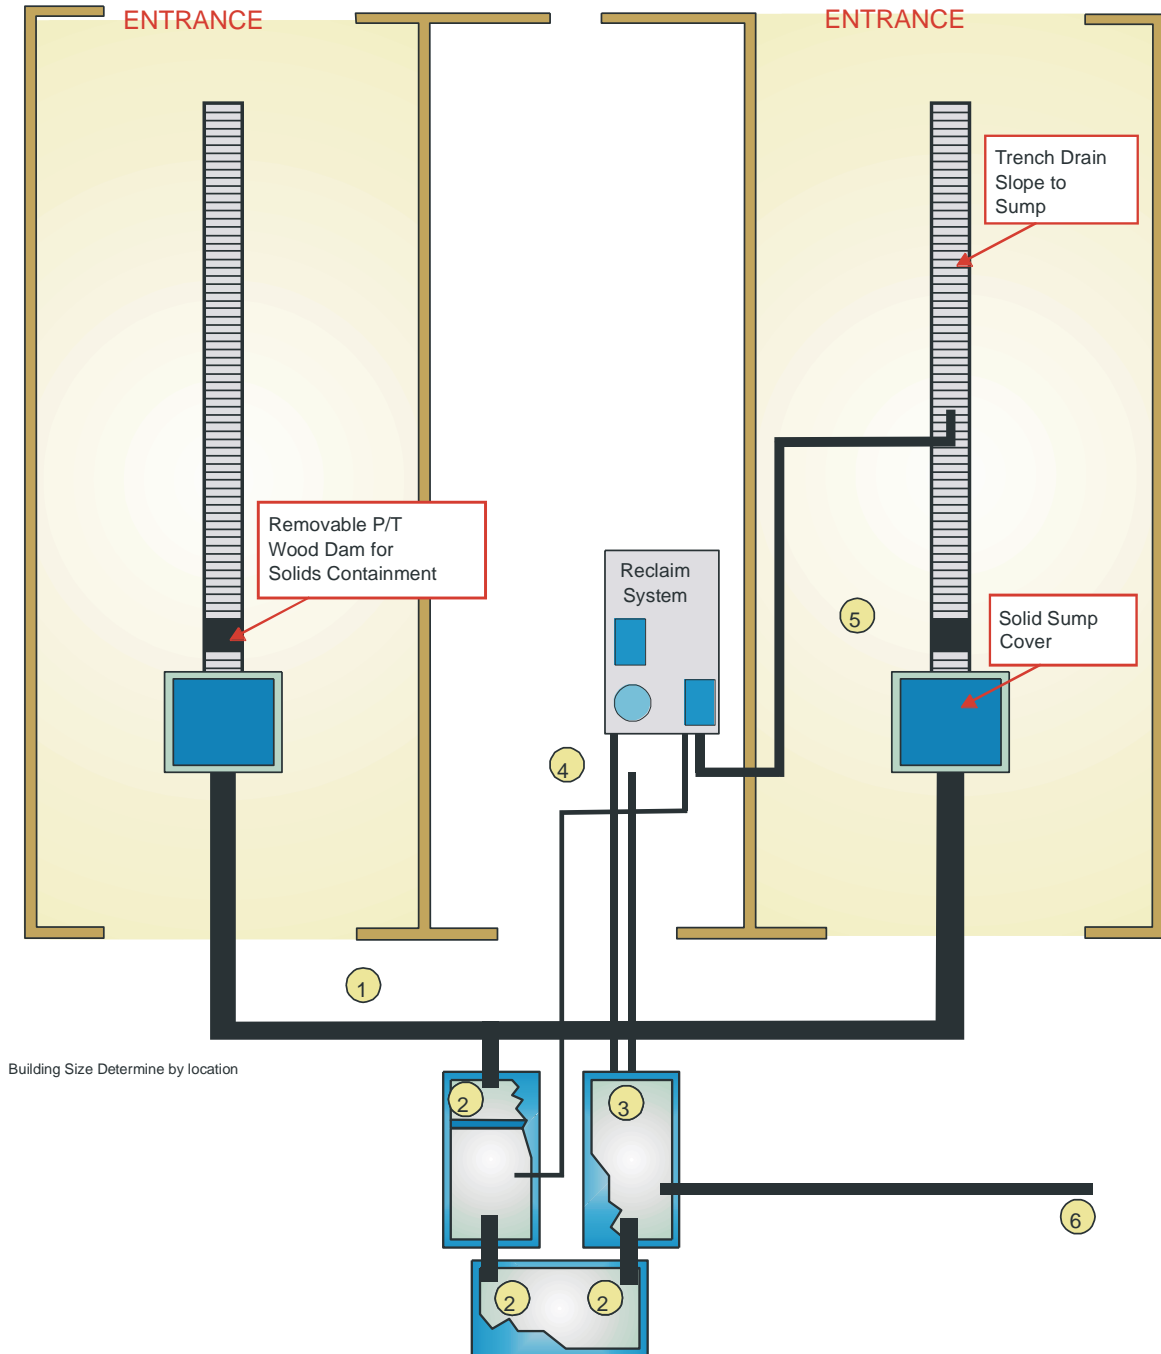

Building Size Determine by location

## Water Flow and Piping Legend

1. 6" PVC Drain Line from mud pits to reclaim tanks. Terminate with tee set horizontally.
2. 6" PVC Interconnect, plumb with tee set vertically, cap top clean out.
3. 3 HP Pumps use Two 2" PVC Sch 80 Suction Lines (one is a spare line)  
 5 HP Pumps and greater use Two 3" PVC Sch 80 Suction Lines
4. 1 1/4" PVC Ozone Return Line, terminate with tee set horizontally.
5. 3" PVC Backwash / Separator Return Line, terminate with elbow set horizontally.
6. 4" / 6" PVC Overflow to Sanitary Sewer.